


Fig-1 床衝撃音レベル(重量音)

測定日	: 平成20年 4月1日
測定場所	: ハイネスコーポ
測定箇所	: 303号室 L D K 床
音源室	: 303号室 洋室
受音室	: 203号室 L D K

		LCmax特性 (動特性:FAST)							
		中心周波数 [Hz]							
		63	125	250	500	1k	2k	4k	
音源位置	受音位置								
1	11	74	68	64	55	42	36	27	
	12	72	67	58	48	39	35	30	
	13	73	67	60	50	40	34	28	
	14	72	67	61	50	40	34	29	
	15	73	66	60	50	40	37	36	
	エネルギー平均値 [dB]	72.9	67.0	61.1	51.3	40.3	35.4	31.4	
2	21	83	63	56	48	40	35	45	
	22	77	61	53	46	40	34	32	
	23	77	62	58	47	41	36	32	
	24	78	63	54	46	40	39	31	
	25	78	63	53	46	39	35	34	
	エネルギー平均値 [dB]	79.3	62.5	55.3	46.7	40.0	36.2	38.9	
3	31	86	65	62	54	45	41	35	
	32	80	66	61	53	45	39	35	
	33	79	68	65	53	46	40	37	
	34	78	67	64	53	46	40	37	
	35	79	65	64	52	46	40	37	
	エネルギー平均値 [dB]	81.6	66.4	63.4	53.0	45.6	40.0	36.3	
4	41	79	63	59	51	43	37	37	
	41	75	66	59	50	42	38	36	
	41	75	64	59	48	41	35	36	
	41	80	62	59	49	42	40	41	
	41	77	65	59	49	41	36	35	
	エネルギー平均値 [dB]	77.7	64.2	59.0	49.5	41.9	37.6	37.6	
5	51	84	64	60	52	43	36	33	
	51	78	67	58	51	43	38	36	
	51	74	65	62	50	43	36	35	
	51	82	65	60	49	43	35	35	
	51	83	64	61	51	44	35	34	
	エネルギー平均値 [dB]	81.4	65.1	60.4	50.7	43.2	36.1	34.7	
平均値 [dB]		78.6	65.1	59.8	50.3	42.2	37.1	35.8	
暗騒音レベル [dB]		53.0	49.0	42.0	42.0	36.0	35.0	30.0	
補正值 [dB]		0.0	0.0	0.0	-1.0	-1.0		-2.0	
床衝撃音レベル [dB]		78.6	65.1	59.8	49.3	41.2	37.1	33.8	

: 測定不能

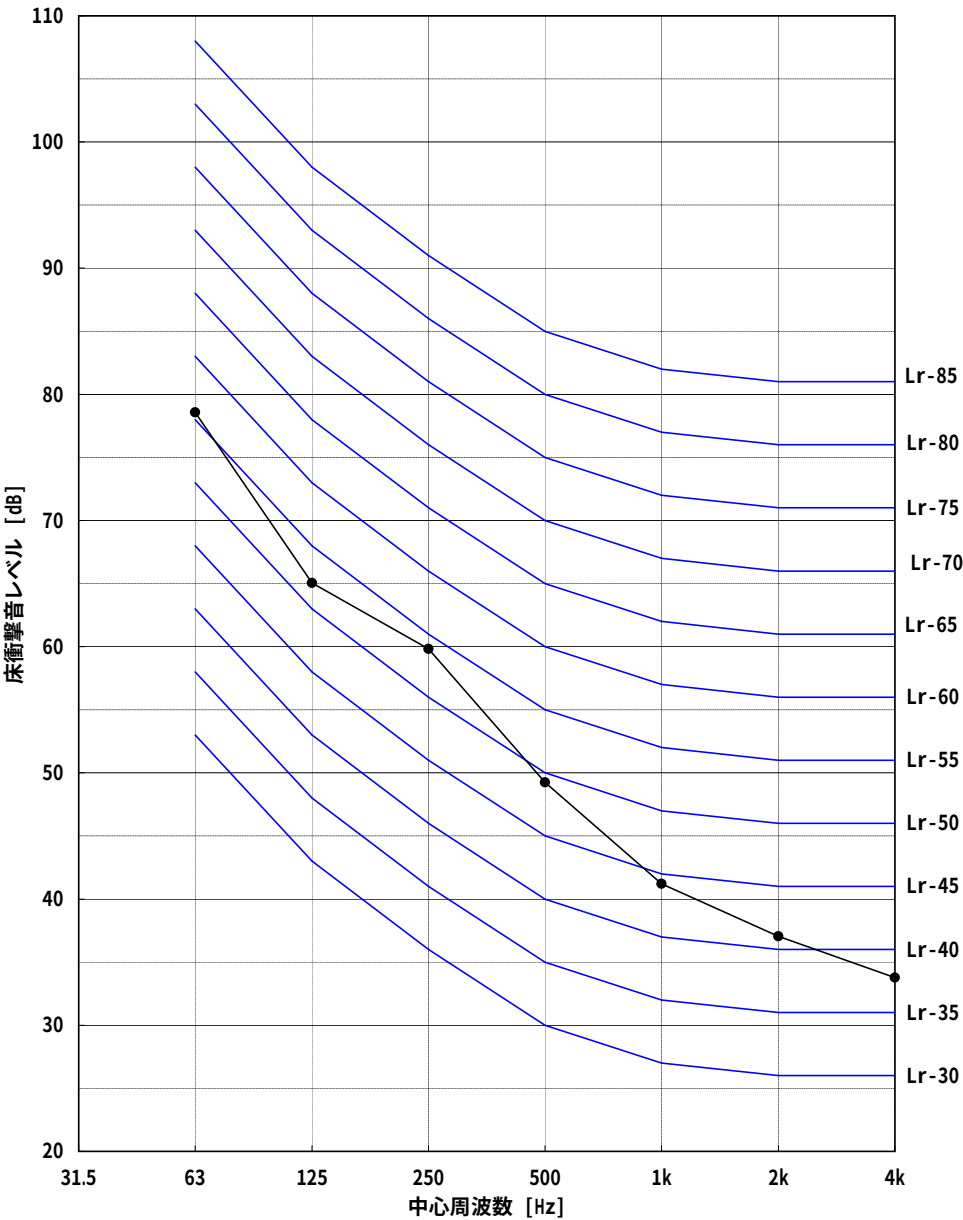

遮音等級	LH -55
------	--------