


Fig - 1 床衝撃音レベル(重量音)

測定日	: 平成20年 1月16日
測定場所	: ハイネスコーポ
測定箇所	: 303号室 L D K 床
音源室	: 303号室 L D K
受音室	: 203号室 L D K

		LCmax特性 (動特性:FAST)							
		中心周波数 [Hz]							
			63	125	250	500	1k	2k	4k
音源位置	受音位置								
1	11		80	67	61	50	44	43	36
	12		81	66	63	51	42	40	36
	13		75	69	66	53	44	37	30
	14		80	70	63	50	43	37	30
	15		75	69	64	51	43	36	32
	エネルギー平均値 [dB]		78.9	68.4	63.7	51.1	43.3	39.4	33.6
2	21		76	64	56	46	40	38	30
	22		80	62	57	47	41	37	33
	23		75	64	58	47	40	37	30
	24		76	64	56	46	40	37	30
	25		72	64	57	48	41	37	30
	エネルギー平均値 [dB]		76.6	63.7	56.9	46.9	40.4	37.2	30.8
3	31		85	74	65	53	46	43	38
	32		90	72	66	54	47	43	45
	33		84	74	66	54	47	41	38
	34		86	73	66	55	48	44	39
	35		82	71	66	54	47	41	38
	エネルギー平均値 [dB]		86.3	73.0	65.8	54.0	47.0	42.6	40.7
4	41		85	71	65	54	47	42	38
	41		86	70	65	54	46	44	37
	41		81	71	66	54	47	46	38
	41		84	70	64	54	48	47	37
	41		76	69	65	54	48	46	38
	エネルギー平均値 [dB]		83.5	70.3	65.0	54.0	47.3	45.3	37.6
5	51		85	70	60	50	44	39	31
	51		87	68	59	52	48	40	31
	51		82	70	61	52	48	41	32
	51		85	70	60	52	47	40	31
	51		79	68	61	54	47	43	32
	エネルギー平均値 [dB]		84.4	69.3	60.3	52.2	47.0	40.8	31.4
平均値 [dB]			81.9	68.9	62.3	51.6	45.0	41.1	34.8
暗騒音レベル [dB]			51.0	51.0	43.0	43.0	37.0	36.0	28.0
補正値 [dB]			0.0	0.0	0.0	-1.0	-1.0	-2.0	-1.0
床衝撃音レベル [dB]			81.9	68.9	62.3	50.6	44.0	39.1	33.8

: 測定不能

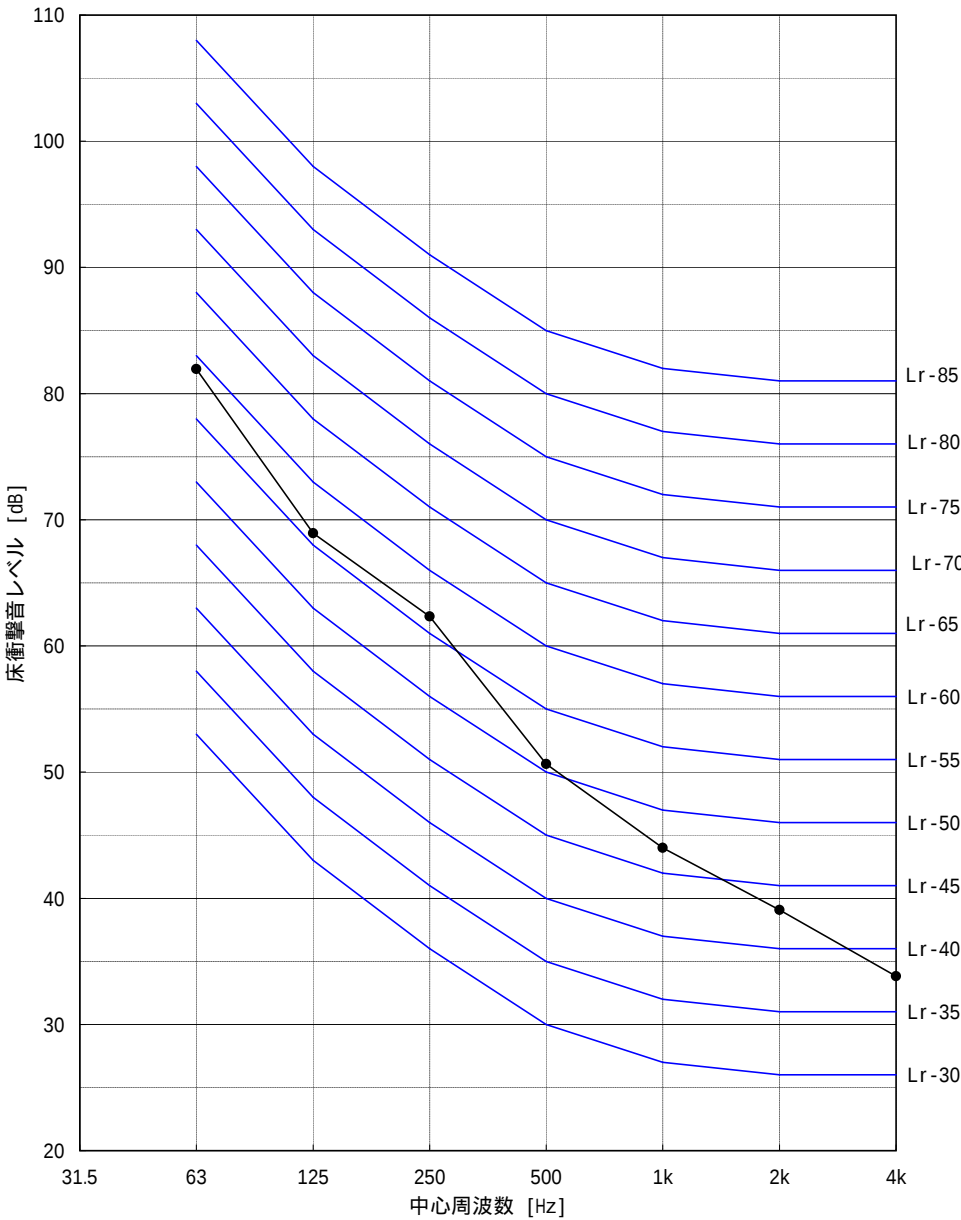

遮音等級

LH -60

小数点以下四捨五入読み