


Fig - 2 床衝撃音レベル(軽量音)

測定日	: 平成20年 4月1日
測定場所	: ハイネスコーポ
測定箇所	: 303号室 L D K 床
音源室	: 303号室 洋室
受音室	: 203号室 L D K

		LCeq特性 (動特性:FAST)						
		中心周波数 [Hz]						
		63	125	250	500	1k	2k	4k
音源位置	受音位置							
1	11	66	59	51	42	37	33	30
	12	62	58	54	43	37	33	30
	13	67	61	53	43	37	34	30
	14	65	60	53	44	37	34	30
	15	68	60	53	43	37	34	30
	エネルギー平均値 [dB]	66.0	59.7	52.9	43.0	37.0	33.6	30.0
2	21	67	57	51	42	36	33	30
	22	62	56	52	42	37	33	30
	23	62	57	52	42	36	32	30
	24	63	56	52	43	37	35	31
	25	66	58	53	42	36	32	30
	エネルギー平均値 [dB]	64.5	56.9	52.0	42.2	36.4	33.1	30.2
3	31	68	55	47	43	37	35	30
	32	62	58	48	43	37	35	31
	33	64	58	48	43	37	34	30
	34	63	58	48	42	37	34	30
	35	65	58	48	42	37	32	30
	エネルギー平均値 [dB]	64.9	57.5	47.8	42.6	37.0	34.1	30.2
4	41	66	54	48	42	37	35	31
	41	64	58	50	44	38	35	30
	41	62	56	49	42	37	34	30
	41	67	56	47	43	36	33	30
	41	66	57	48	42	37	34	30
	エネルギー平均値 [dB]	65.3	56.4	48.5	42.7	37.0	34.3	30.2
5	51	71	55	48	42	36	32	30
	51	62	56	48	42	37	33	30
	51	63	57	49	42	36	34	30
	51	67	58	48	43	36	33	30
	51	70	59	48	41	36	32	30
	エネルギー平均値 [dB]	67.9	57.2	48.2	42.0	36.2	32.9	30.0
平均値 [dB]		65.8	57.5	49.9	42.5	36.7	33.6	30.1
暗騒音レベル [dB]		53.0	49.0	42.0	42.0	36.0	35.0	30.0
補正值 [dB]		0.0	-1.0	-1.0				
床衝撃音レベル [dB]		65.8	56.5	48.9	42.5	36.7	33.6	30.1

: 測定不能

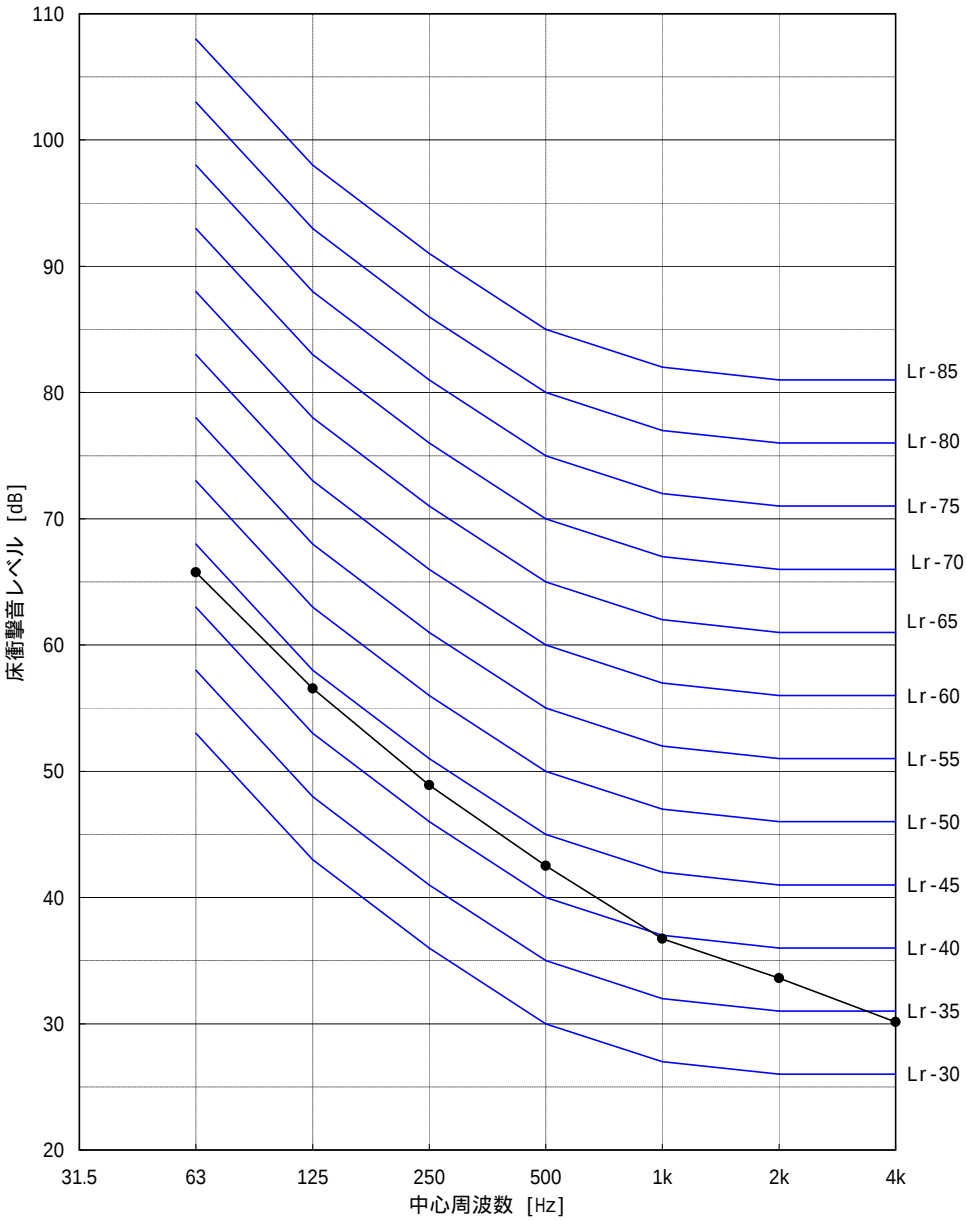

遮音等級	LL - 45
------	---------

小数点以下四捨五入読み