


Fig - 2 床衝撃音レベル(軽量音)

測 定 日	: 平成20年 1月16日
測定場所	: ハイネスコーポ
測定箇所	: 303号室 L D K 床
音 源 室	: 303号室 L D K
受 音 室	: 203号室 L D K

		LCeq特性 (動特性:FAST)							
		中心周波数 [Hz]							
		63	125	250	500	1k	2k	4k	
音源位置	受信位置								
1	11	60	63	64	53	45	41	32	
	12	61	62	63	53	45	40	30	
	13	63	66	63	53	45	41	30	
	14	63	64	63	53	45	41	30	
	15	59	65	63	54	46	41	30	
	エネルギー平均値 [dB]	61.5	64.2	63.2	53.2	45.2	40.8	30.5	
2	21	60	64	69	57	48	43	31	
	22	63	64	70	57	49	44	32	
	23	63	67	70	59	49	43	31	
	24	63	65	68	56	48	42	30	
	25	58	65	69	60	49	45	31	
	エネルギー平均値 [dB]	61.8	65.1	69.3	58.1	48.6	43.5	31.0	
3	31	61	69	67	54	46	39	30	
	32	64	65	67	54	47	40	31	
	33	62	68	66	54	46	39	30	
	34	64	66	64	54	47	35	30	
	35	61	68	68	54	47	40	30	
	エネルギー平均値 [dB]	62.6	67.4	66.6	54.0	46.6	38.9	30.2	
4	41	65	69	66	54	46	41	31	
	41	66	67	66	55	47	40	29	
	41	64	68	67	55	46	41	31	
	41	67	65	63	54	46	40	30	
	41	60	67	66	56	47	40	30	
	エネルギー平均値 [dB]	65.0	67.4	65.8	54.9	46.4	40.4	30.3	
5	51	61	64	65	55	45	40	30	
	51	66	65	67	54	47	41	30	
	51	66	66	66	55	46	41	30	
	51	66	66	65	54	45	39	29	
	51	59	65	66	55	55	24	30	
	エネルギー平均値 [dB]	64.5	65.3	65.9	54.6	49.7	39.4	29.8	
平均値 [dB]		63.1	65.9	66.1	55.0	47.3	40.6	30.4	
暗騒音レベル [dB]		51.0	51.0	43.0	43.0	37.0	36.0	28.0	
補正值 [dB]		0.0	0.0	0.0	0.0	0.0	-2.0		
床衝撃音レベル [dB]		63.1	65.9	66.1	55.0	47.3	38.6	30.4	

: 測定不能

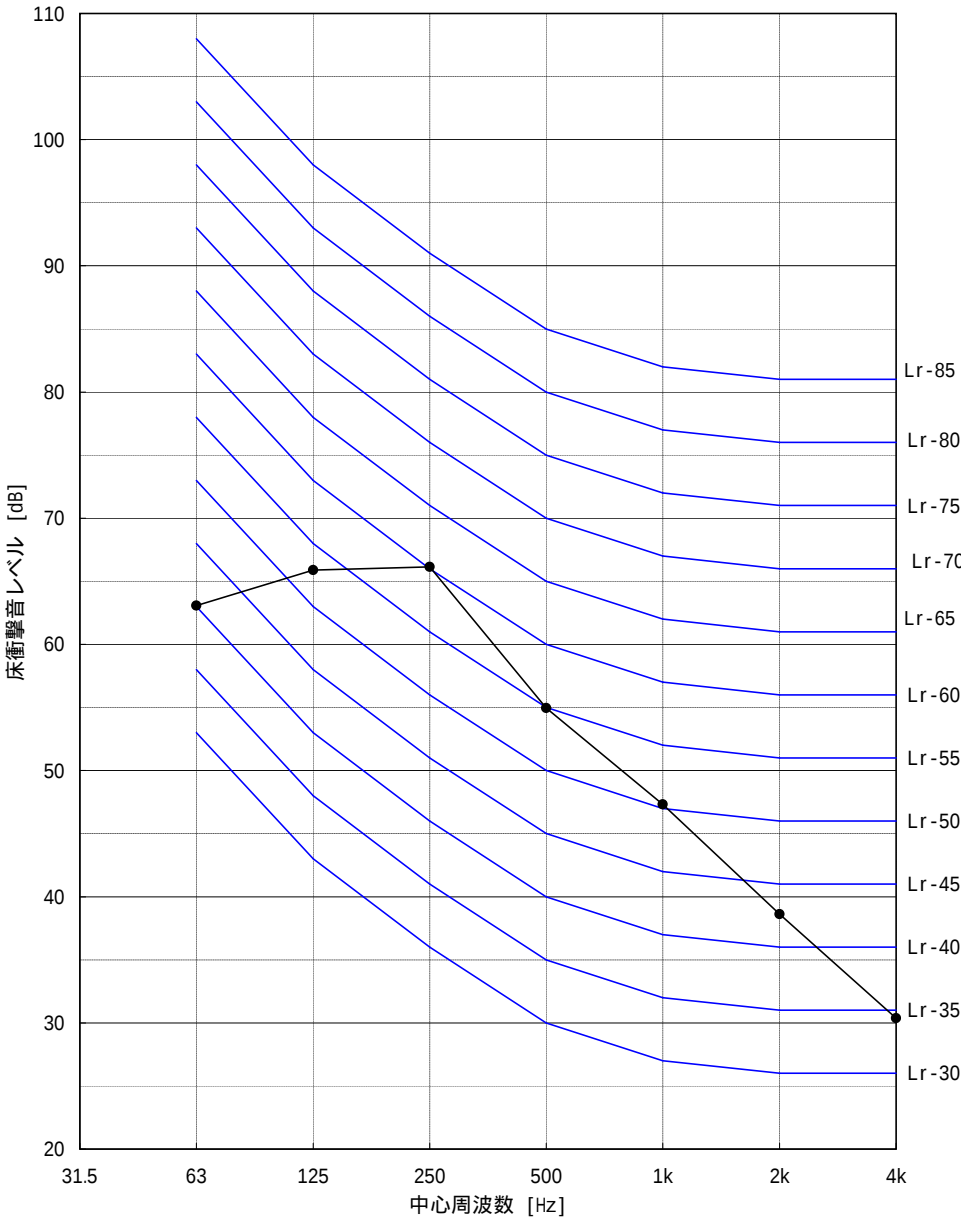

遮音等級	LL - 60
------	---------

小数点以下四捨五入読み